

**LEGENDA**

	Beton gewapend		Bovenrand onafgewerkte niveau
	Beton ongewapend		Snee 1
	Sondering OXX		Snijlijn


Fundatie:	Nummer:
Transformer & Rectifiers F2.1, F2.2, F2.3, F2.4, F2.5, F2.6, F2.7, F2.8, F2.9, F2.10	035230TH-000-CTA010-0008
Pipe Racks F6.1, F6.2, F6.3, F6.4, F6.5, F6.6, F6.7, F6.8, F6.9, F6.10, F6.11, F6.12	035230TH-000-CTA010-0008
Pipe Racks F7.1, F7.2, F7.3, F7.4, F7.5, F7.6, F7.7, F7.8	035230TH-000-CTA010-0008
Pipe Racks F11.1, F11.2, F11.3, F11.4, F11.5, F11.6, F11.7, F11.8, F11.9, F11.10	035230TH-000-CTA010-0008
Pipe Racks F3.1, F3.2, F3.3, F3.4, F8.1, F8.2, F8.3, F8.4, F8.5, F8.6, F8.7, F8.8, F9.1, F9.2, F9.3, F9.4, F9.5, F9.6, F9.7, F9.8, F16.1, F16.2	035230TH-000-CTA010-0008
Buffer Vessel F21.1	035230TH-000-CTA010-0009
Cooling Towers F12.1, F12.2, F12.3, F12.4, F12.5, F12.6	035230TH-000-CTA010-0009
Vent Stack F4	035230TH-000-CTA010-0009
Buffer Vessel F5	035230TH-000-CTA010-0009
Denim Water Tanks F10.2	035230TH-000-CTA010-0009
H2 Measurement F13	035230TH-000-CTA010-0010
Purification Units F15	035230TH-000-CTA010-0010
Power Generator 1 F17	035230TH-000-CTA010-0010
O2 Vent Stacks F18.1, F18.2	035230TH-000-CTA010-0010
HV - Transformer --A00UA001	035230TH-000-CTA010-0016

**Drawing Legende**  
Frost-proof material is to be installed to a depth of 0.8 m if the foundations are not embedded deeper than 0.8 m.


**Building materials**  
Concrete C30/37  
Reinforcement B500  
Werkvloer C12/15

**Referentie tekeningen**

Naam	Nummer	Revisie datum	Revisie
Transformer & Rectifiers, Pipe Racks	035230TH-000-CTA010-0008	2023.04.26	-D
Cooling Towers, Denim Water Tanks, Buffer Vessel, Vent Stacks	035230TH-000-CTA010-0009	2023.04.26	-D
Purification, H2 Measurement, O2 Vent Stacks, Power Generator 1	035230TH-000-CTA010-0010	2023.04.26	-C
HV - Transformer	035230TH-000-CTA010-0016	2023.04.26	-B

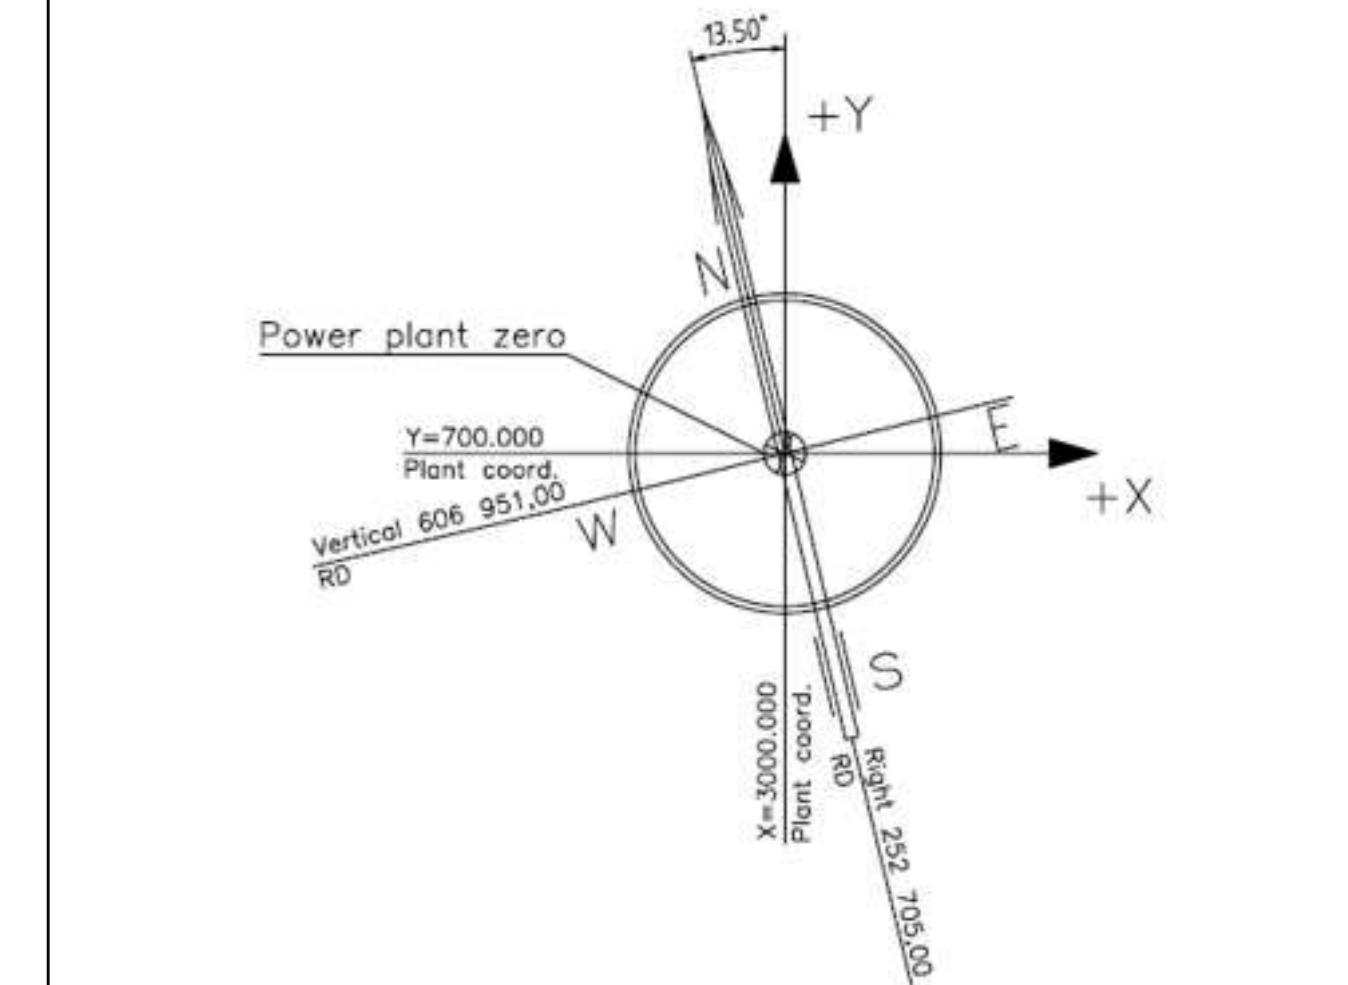

Ground level existing powerplant = 4.70m + NAP = EL. +0.00m  
 Ground level Eemshydrogen = 5.30m + NAP = EL. +0.60m  
 Site finished grade Eemshydrogen = 5.10m + NAP = EL. +0.40m

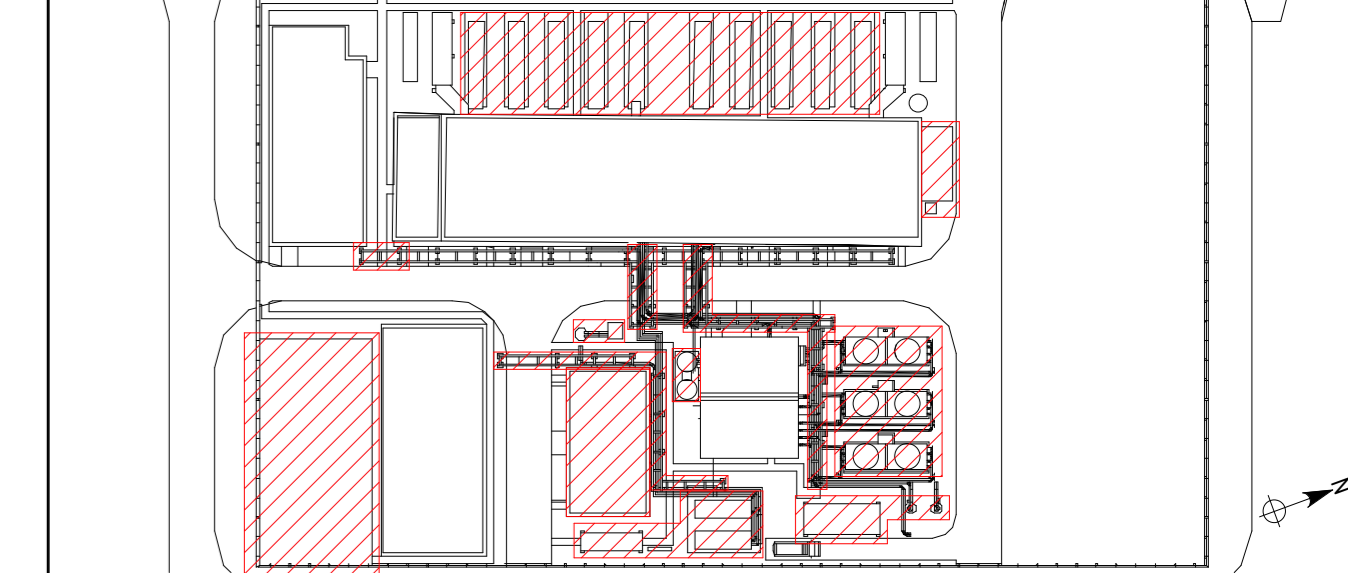

Planner: HOCHTIEF	Getekend van: Henrds	Opsteller plan: T.-sr.	Revisie: D	Revisie datum: 2023.04.26
<b>RWE</b>		RWE Technology International GmbH		Ernestinestr. 60, 45141 Essen
get: 2023.02.05	gecorr: 2023.02.05	afgepr: 2023.02.05	afgepr: 2023.02.05	afgepr: 2023.02.05
Eemsh2 Unit A		Overview Foundations		
overview outdoor foundations				

Tekening nummer: 035230TH-000-CTA010-0007

revisie	datum	geleend	gecont.	afgepr.	omschrijving
D	2023.04.26	Henrds	Mabum	Zinnert	Overall Update (Comments 17.04.2023)
C	2023.04.06	Henrds	Mabum	Zinnert	Overall Update (Protocol No 1 RWE 23.03.2023)
B	2023.03.21	Henrds	Mabum	Zinnert	Overall Update (Protocol No 1 RWE 21.02.2023)
A	2023.01.24	Henrds	Mabum	Zinnert	First issue

VOORLEGGER: TEKENING IS AUTOGESCHRIJFTELIJK BESCHERMD. EEBERE VERVEELVOLDIGING, LOEK VAN FRAGMENTEN, IS VERBODEN.

revisie	datum	geleend	gecont.	afgepr.	omschrijving
D	2023.04.26	Henrds	Mabum	Zinnert	Overall Update (Comments 17.04.2023)
C	2023.04.06	Henrds	Mabum	Zinnert	Overall Update (Protocol No 1 RWE 23.03.2023)
B	2023.03.21	Henrds	Mabum	Zinnert	Overall Update (Protocol No 1 RWE 21.02.2023)
A	2023.01.24	Henrds	Mabum	Zinnert	First issue