



22/11/2024 09:34:19


AIR QUALITY TRANSMITTER COMMS SIGNALS/ LUCHTKWALITEIT ZENDER COMMUNICATIE SIGNALLEN

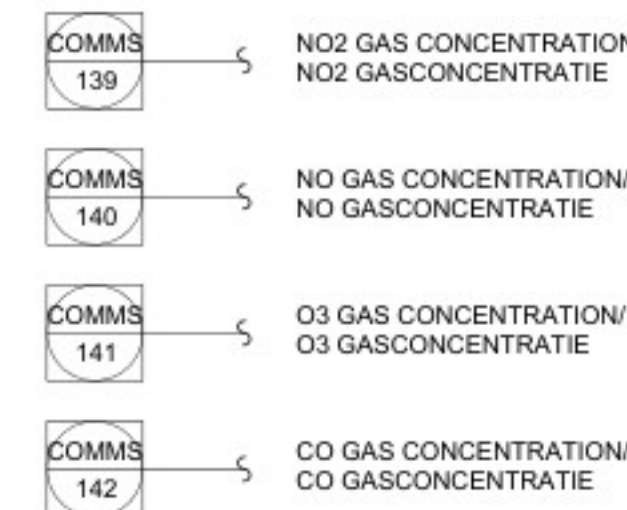

WEATHER STATION & MISC EXTERNAL I/Os/ WEERSTATION & DIVERSE EXTERNE I/O's

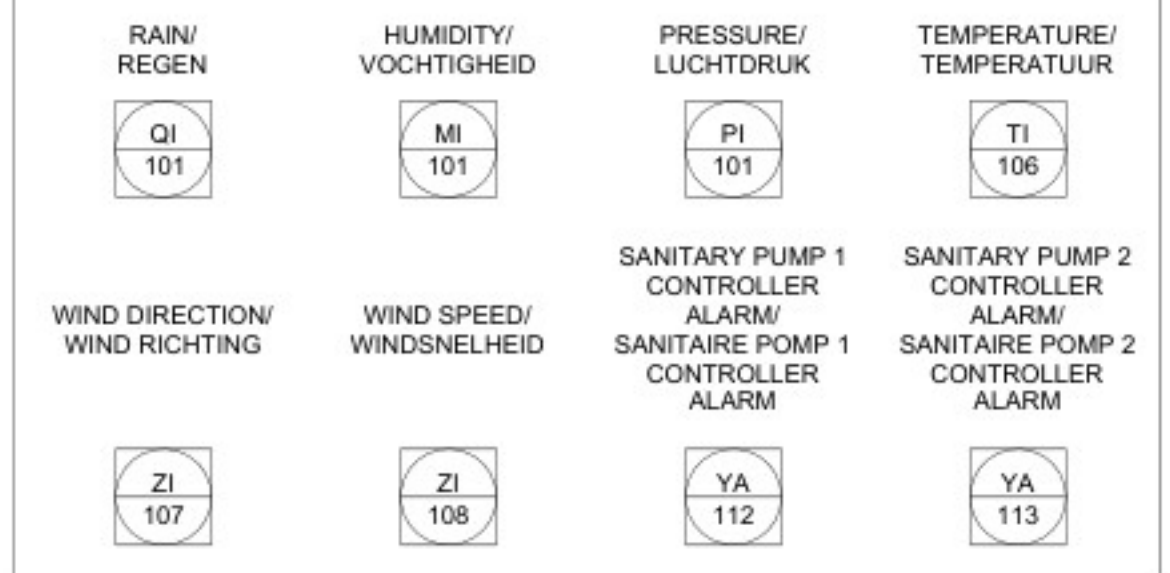


MISCELLANEOUS I/Os DIVERSE I/O's

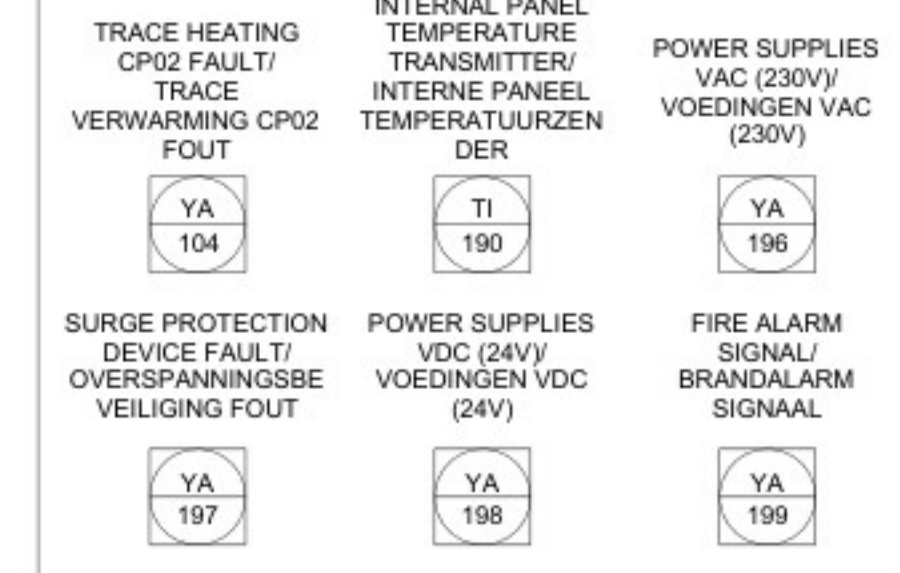

DUCTWORK LEGEND/LEGENDA KANALEN:



LEGENDS/LEGENDA:

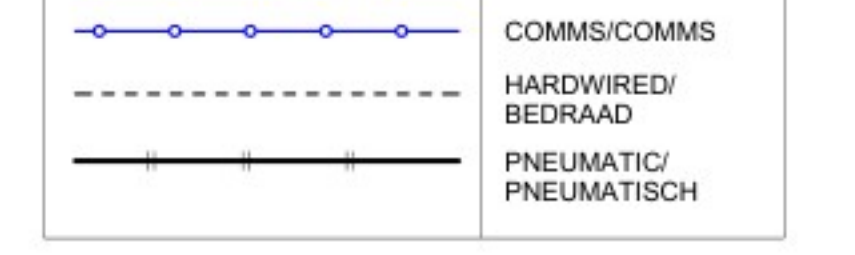

- NOTES:**
- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL PROJECT ISSUED DOCUMENTS.
 - FRESH AIR FOR RESTROOMS IS SUPPLIED TO THE RESTROOMS VESTIBULES.
 - FRESH AIR TO CONTROL ROOM 1-227 IS SUPPLIED THROUGH N+1 FCUs.
 - DUCTS SUPPLYING FRESH AIR TO FCUs WILL HAVE AN OPEN BELL MOUTH WITH A FLY SCREEN.
 - LEAK DETECTION SENSOR IN DC SOC TO SERVE 2N+1 LEAK DETECTION POINTS, ONE IN EACH FCU DRIP TRAY.
- OPMERKINGEN:**
- DEZE TEKENING MOET WORDEN GELEZEN IN COMBINATIE MET ALLE DOCUMENTEN DIE VOOR HET PROJECT ZUN UITGEGEVEN.
 - VERSE LUCHT VOOR TOILETTEN WORDT TOEGEVOERD AAN DE VESTIBULES VAN DE TOILETTEN.
 - VERSE LUCHT NAAR CONTROLEKAMER 1-227 WORDT GELEVERD DOOR N+1 FCU'S (FAN COIL UNIT).
 - KANALEN DIE VERSE LUCHT AAN FCUS LEVEREN ZULLEN EEN OPEN INLAATMOND HEBBEN MET EEN VLEGENWIK.
 - LEKDETECTIESENSOR IN DC SOC VOOR TWEE LEKDETECTIEPUNTEN, 4N IN ELKE FCU LEKBAK.

DC SOC FCU DRIP PAN LEAK DETECTION DETAIL / DC SOC FCU DETAILS LEKDETECTIE LEKBAK

